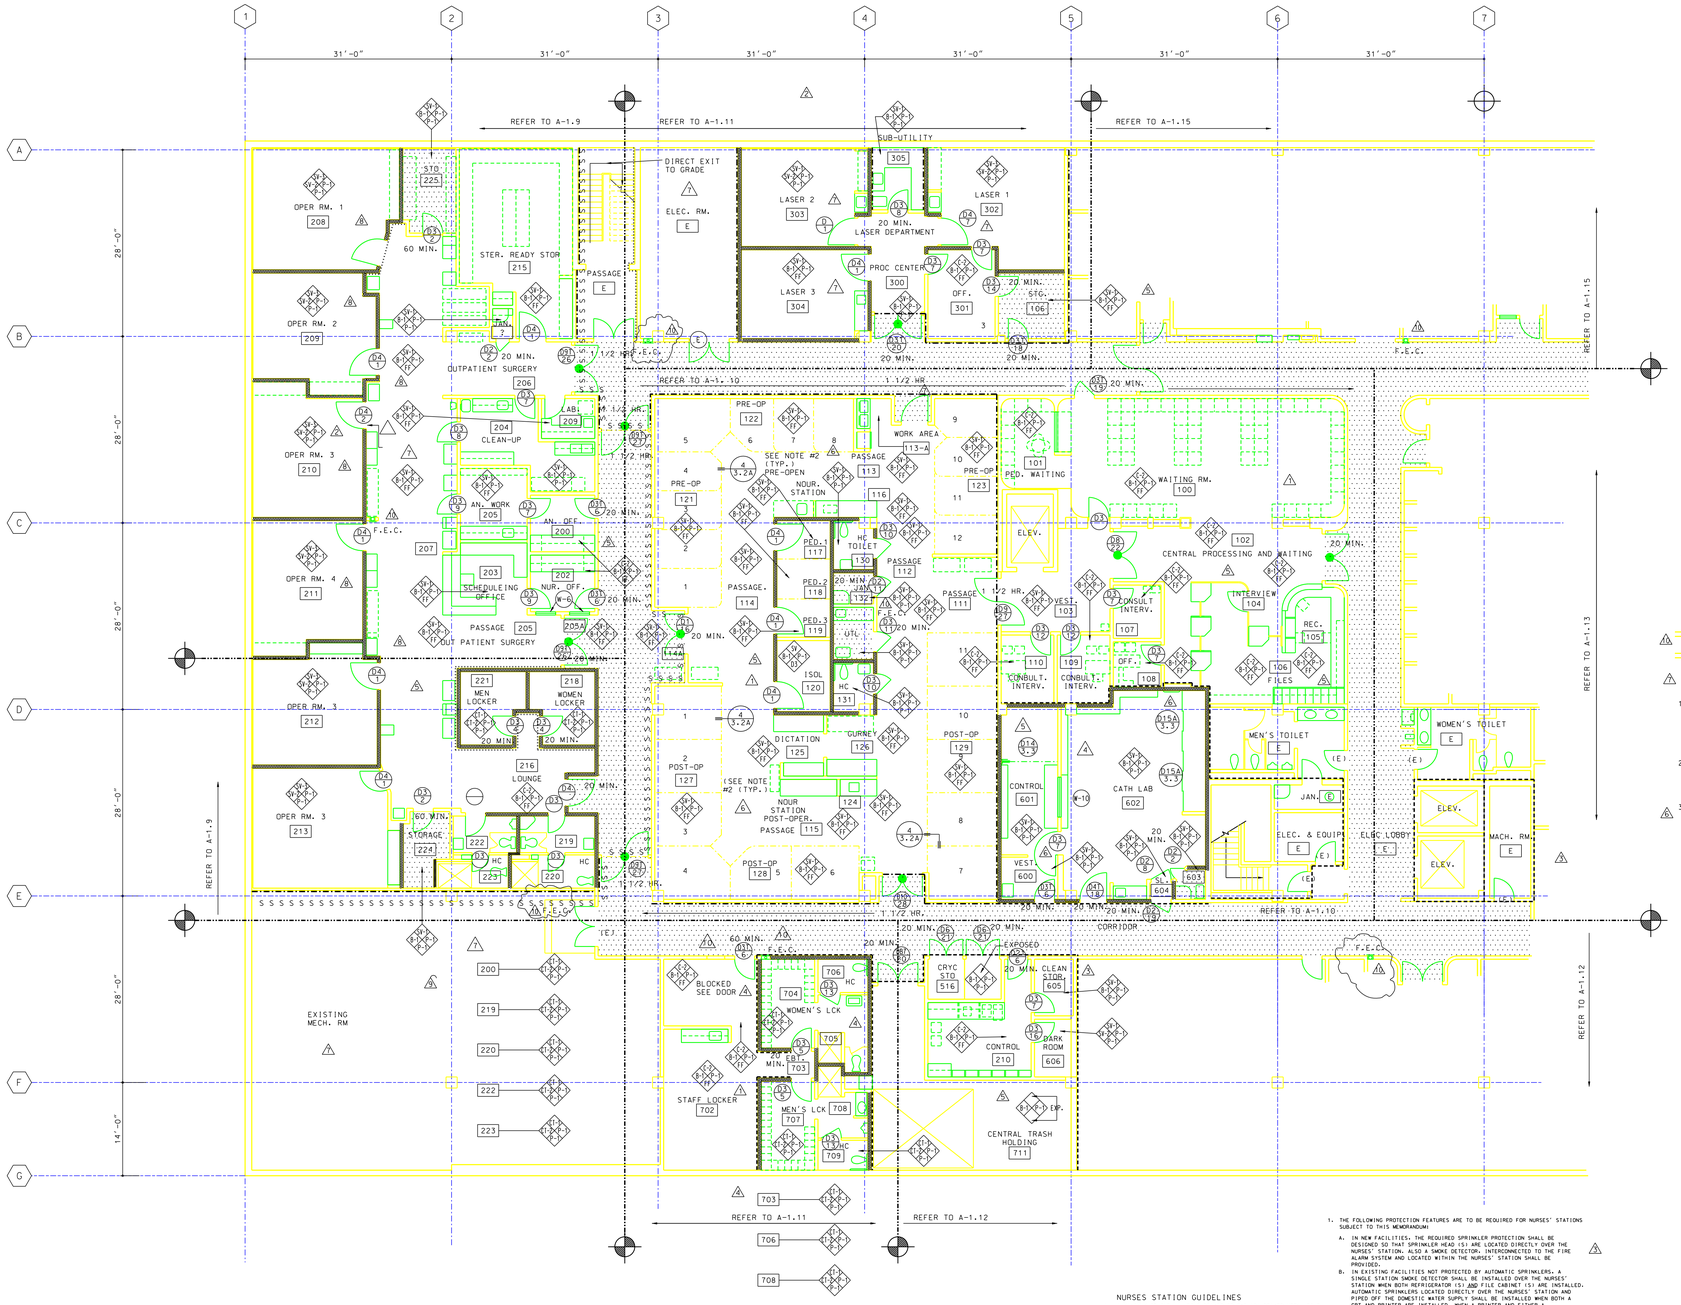

WALL LEGEND:

- 1-HR PARTITION WALL
- 2-HR PARTITION WALL
- NON-RATED PARTITION WALL WITH ACOUST. INSUL. WHERE NOTED
- NON-RATED PARTITION WALL
- STEEL ℄ SHIELDED PARTITION
- LEAD SHIELDED PARTITION
- 1-HR RATED CORRIDOR/ROOM (TUNNEL TYPE)
- EXISTING PARTITIONS & COLUMNS (SCREENED OR DAHSED Ø1/8" PLANS)
- EXISTING PARTITIONS & COLUMNS (POCHE'D Ø1/4" PLANS OR DETAILS)
- EXIST'G PARTITION TO BE REMOVED WHERE NOTED
- NEW WALL

REFERENCE SYMBOLS:

- ROOM NUMBER
- DOOR TYPE AND HARDWARE NUMBER
- WINDOW TYPE
- LOUVER TYPE
- EQUIPMENT NUMBER
- FLOOR FINISH / WALL FINISH / CEILING FINISH / BASE FINISH
- (BC) WC — CABINET TYPE ON FLR. PLANS AND ELEVATIONS / WALL CABINET
- (E) EXISTING ITEM
- (N) NEW ITEM
- (R) RELOCATED EXISTING ITEM
- S S S S S — SMOKE PARTITION (1-HOUR MINIMUM)
- PANIC DOOR HARDWARE

F.E.C. : 10 LB DRY CHEMICAL FIRE EXTINGUISHER CABINET (SEMI-RECESSED)

F.E.C. : 10 LB DRY CHEMICAL FIRE EXTINGUISHER CABINET (SURFACE)

NOTES:

1. ALL RATED DOORS TO BE POSITIVE LATCHING

   "LABEL" SHALL MEAN "ASSEMBLY AS DEFINED IN SECTION 4306(B) UBC 1979 ALL 90, 60 & 20 MIN RATED ASSEMBLIES SHALL BE PROVIDED WITH APPROVED GASKETING MATERIAL SO INSTALLED TO PROVIDE A SEAL WHERE THE DOOR MEETS THE STOP ON BOTH SIDES AND ACROSS THE TOP. (UBC STDS 43.210)

2. POST-OP/PRE-OP: PATIENT CHANGE AREA TO OCCUR WITHIN THEIR RESPECTIVE CUBICLE STATIONS. PERSONAL CLOTHING SHALL ACCOMPANY GURNEY WITH PATIENT.

3. FIELD VERIFY F.E.C. LOCATION WITH 75'-0" MAX TRAVELING DISTANCE FROM ANY POINT.

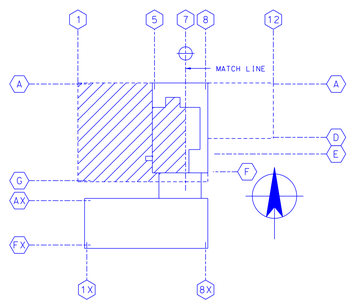

KEY PLAN
N.T.S.

NURSES STATION GUIDELINES

A. A MAXIMUM OF ONE (1) FOUR-DRAWER OR TWO (2) DRAWER METAL FILE CABINETS FOR THE STORAGE OF PATIENT RECORDS AND BLANK FORMS.

B. FORMS AND OTHER PAPER SUPPLIES OTHER THEN THOSE NEEDED FOR ONE DAY'S ACTIVITIES SHALL BE STORED IN THE METAL FILE CABINETS (S). BACK-UP PAPER SUPPLIES SHALL NOT BE STORED IN THE OPEN AREA OF THE NURSES' STATION.

C. A MAXIMUM OF TWO (2) UNDERCOUNTER REFRIGERATORS OR ONE (1) UPRIGHT REFRIGERATOR LIMITED TO THE STORAGE OF PATIENT MEDICATIONS OR PATIENT FOODS REQUIRING REFRIGERATION. THE REFRIGERATORS SHALL BE OF RECENT MANUFACTURE AND SHALL BE IN GOOD CONDITION USING FREON AS THE REFRIGERANT.

D. A MAXIMUM OF TWO (2) COMPUTER PRINTERS WITH THEIR INTREVAL PAPER SUPPLIES.

E. 1. UNLIMITED QUANTITY OF COMPUTER INPUT KEYBOARDS.
   2. UNLIMITED QUANTITY OF COMPUTER VIEWING SCREENS (CRT'S).
   3. UNLIMITED QUANTITY OF ELECTRONIC PATIENT CONTROLS.

F. CHAIRS SHALL BE PERMITTED IN ALL NURSES' STATIONS. THE QUANTITY MAY BE SUFFICIENT TO ACCOMODATE THE NEED. ANY UPHOLSTERED CHAIRS SHALL HAVE FIRE RETARDANT PADDING AND COVERINGS.

G. REFRIGERATED VENDING EQUIPMENT OR SIMILAR EQUIPMENT WILL NOT BE PERMITTED IN CORRIDORS.

1. THE FOLLOWING PROTECTION FEATURES ARE TO BE REQUIRED FOR NURSES' STATIONS SUBJECT TO THIS MEMORANDUM

   A. IN NEW FACILITIES, THE REQUIRED SPRINKLER PROTECTION SHALL BE DESIGNED SO THAT SPRINKLER HEAD (S) ARE LOCATED DIRECTLY OVER THE NURSES' STATION. ALSO A SMOKE DETECTOR, INTERCONNECTED TO THE FIRE ALARM SYSTEM AND LOCATED WITHIN THE NURSES' STATION SHALL BE PROVIDED.

   B. IN EXISTING FACILITIES NOT PROTECTED BY AUTOMATIC SPRINKLERS, A SINGLE STATION SMOKE DETECTOR SHALL BE INSTALLED OVER THE NURSES' STATION WHEN BOTH REFRIGERATOR (S) AND FILE CABINET (S) ARE INSTALLED. AUTOMATIC SPRINKLERS LOCATED DIRECTLY OVER THE NURSES' STATION AND PIPED OFF THE DOMESTIC WATER SUPPLY SHALL BE INSTALLED WHEN BOTH A CRT AND PRINTER ARE INSTALLED. WHEN A PRINTER AND EITHER A REFRIGERATOR (S) OR FILE CABINET (S) ARE INSTALLED. AUTOMATIC SPRINKLERS AS SET FORTH ABOVE SHALL BE PROVIDED.

   C. IN EXISTING FACILITIES WHICH ARE PROTECTED BY AUTOMATIC SPRINKLER AND A SMOKE DETECTION SYSTEM WHICH COVERS AT LEAST THE CORRIDORS ON THE SAME FLOOR AS THE NURSES' STATION, A SINGLE-STATION SMOKE DETECTOR SHALL BE INSTALLED OVER THE NURSES' STATION WHEN BOTH REFRIGERATOR (S) AND FILE CABINETS ARE INSTALLED. OR BOTH A CRT AND PRINTER ARE INSTALLED.

   D. IN EXISTING FACILITIES WHICH ARE PROTECTED BY AUTOMATIC SPRINKLERS AND A SMOKE DETECTION SYSTEM WHICH COVERS AT LEAST THE CORRIDORS THE FACILITY MUST COMPLY WITH THE LIMITATIONS SEE FORTH IN 1A THROUGH F.

   E. IN EXISTING FACILITIES WITH A SMOKE DETECTION SYSTEM WHICH COVERS AT LEAST THE CORRIDORS ON THE SAME FLOOR AS THE NURSES' STATION. AUTOMATIC SPRINKLERS SHALL BE PROVIDED WHEN BOTH A CRT AND PRINTER ARE INSTALLED. SPRINKLERS SHALL BE INSTALLED OVER THE NURSES' STATION AND MAY BE SUPPLIED FROM THE DOMESTIC WATER PIPING.

   F. TRASH CONTAINERS SHALL BE PROVIDED AT ALL NURSES' STATIONS. THESE CONTAINERS SHALL BE OF NON-COMBUSTIBLE MATERIALS OR SHALL BE OF A TYPE APPROVED BY THE STATE FIRE MARSHAL.

IT WILL CONTINUE TO BE THE POLICY OF THE OFFICE OF THE STATE FIRE MARSHAL TO BE AWARE AND CONCERNED WITH INTRUSIONS INTO REQUIRED EXITWAYS, AND. IT IS NOT THE INTENT OF THIS MEMORANDUM TO SUBORDINATE THE NECESSITY OF EXITWAYS TO MERE CONVENIENCE OF PATIENT CARE. RATHER, WE RECOGNIZE THERE ARE CONDITIONS OF MEDICAL NECESSITY AND A CONTINUING EVOLUTION IN MEDICAL CARE FOR PATIENTS IN A HOSPITAL ENVIRONMENT. THE SITUATIONS WHICH ARE DELINEATED HEREIN ARE DEEMED TO PROVIDE EQUIVALENT PROTECTION.

800.700.3305

Q-CAD CAD PAPER TO CAD

ARCHITECTURAL